



Art.-Nr: AXCT009ML-E

**Exit sign, Safety luminaire Centralised power supply systems
Ceiling mounting, ML, CPS, 30 m, IP20, Zinc die-cast,
Stainless steel**

The AXCT is a zinc-diecast exit sign with cord suspension for recessed ceiling mounting and for the marking of escape routes. It is part of a complete luminaire series, which features solutions for every mounting situation and was honored with the German Design Award. Luminaires of the A-Series are equipped with modern LED illuminants and offer flexibility with changeable pictograms. The AXCT features Duo-technology and enlightens also the rescue route in the area of the exit sign.

LED exit sign according to EN 60598-1, EN 60598-2-22, EN 7010 and EN 1838



[More information](#)



TECHNICAL DATA


Luminaire type	Exit sign, Safety luminaire
Mounting	Ceiling mounting
Recognition distance	30 m
Pictograph	Set
Illuminant	LED
Housing material	Zinc die-cast
Housing color	Stainless steel
Protection type (IP)	IP20
Impact resistance (IK)	≥ 3
Certification	WEEE, CE
Insulation class	2
Supply	Centralised power supply systems
Monitoring	ML
Bridging time	CPS
Operating mode	single luminaire switching
Input voltage AC	230 V
Input frequency	50 / 60 Hz
Input voltage DC	216 V
Power max.	4,9 W



Power DS	3,4 W
Power BS	1,1 W
Depth	80 mm
Width	312 mm
Height	181 mm
Installation length	176 mm
Installation width	68 mm
Installation height	40 mm
Weight	1.9
Weight incl. packaging	2.39
Connection cross-section	2.5 mm ²
Switching input	Yes
Emergency light blocking	No
Battery connection	No
Dimming function	Yes
Luminous flux emergency	100 lm
Customs tariff number	94056180
Country of origin	DEUTSCHLAND
EAN	4260581715298



TECHNICAL DRAWING

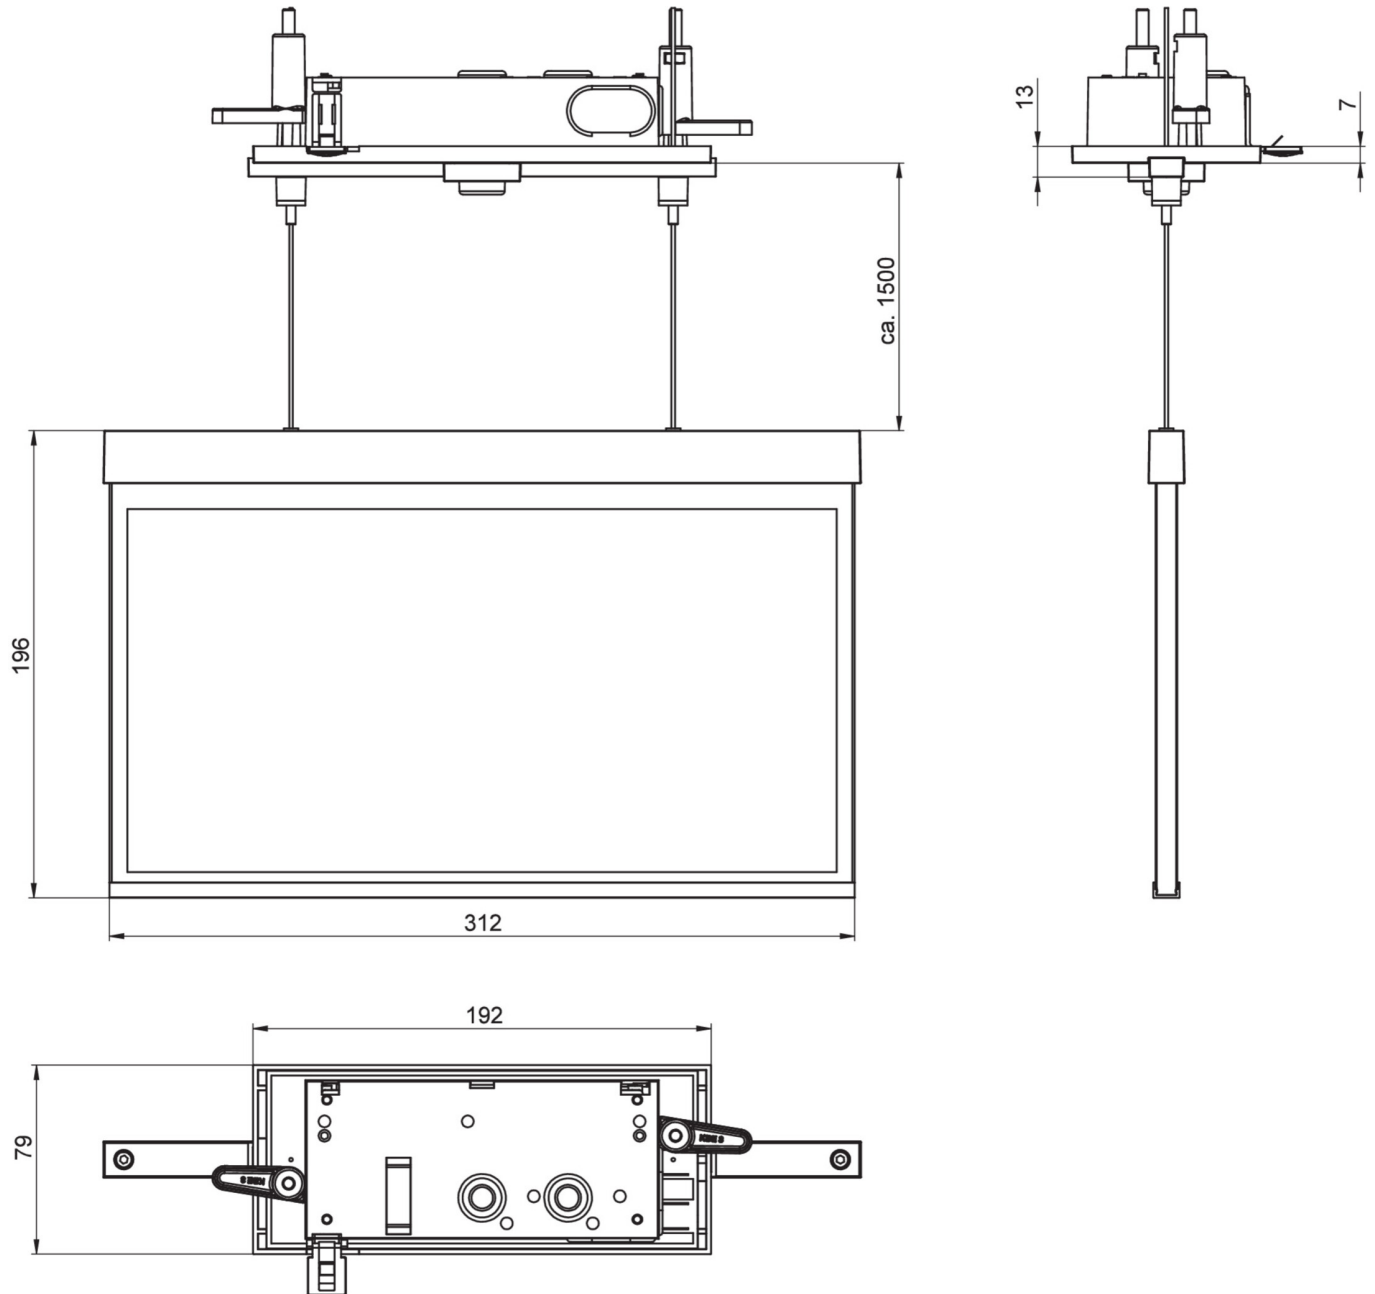

ACCESSORY LIST

AM-XBE -



RELATED PRODUCTS

Art.-No.	Image	Monitoring	Supply	Color	Investment	Automatic log	Maintenance level	Remote maintenance	max. luminaires	Single luminaire monitoring
AXCT009ML		ML	Central power supply		€€€	Yes	low	Yes	1,920 per system	central
AXCT009ML-AZ		ML	Central power supply		€€€	Yes	low	Yes	1,920 per system	central

As of: 09.07.2024 - Subject to technical changes and errors.