



Art.-Nr: KSU018WB
Exit sign Single Battery
Universal, Wireless Basic, 8 h, 22 m, IP54, Plastic, white

Innovative polycarbonate edge LED luminaire for universal mounting. The installation using only 3 parts is kept simple.

Applicable for maintained or non-maintained operation mode. The toolless change and variable use of the pictograms provide planning security. Universal pictogram set (left, right, up, down) included. Exit sign according to EN 60598-1, EN 605982-22 and EN 1838 norms.



More information



TECHNICAL DATA


Luminaire type	Exit sign
Mounting	Universal
Recognition distance	22 m
Pictograph	Set
Illuminant	LED
Housing material	Plastic
Housing color	white
Protection type (IP)	IP54
Impact resistance (IK)	≥ 3
Certification	Waste disposal, CE
Insulation class	2
Supply	Single Battery
Monitoring	Wireless Basic
Bridging time	8 h
Battery	LiFePO4 3,2 V / 3,3 Ah LiFePO4 - Lithium Iron Phosphate Battery
Operating mode	Standby circuit / permanent circuit
Input voltage AC	230 V
Input frequency	50 / 60 Hz
Input voltage DC	- V
Power max.	5,3 W
Power DS	3,9 W



Power BS	1,5 W
Depth	34 mm
Width	250 mm
Height	174 mm
Weight	0.7
Weight incl. packaging	0.78
Connection cross-section	2.5 mm ²
Switching input	Yes
Emergency light blocking	No
Battery connection	Connector
Dimming function	No
Luminous flux mains	190 lm
Luminous flux emergency	85 lm
Customs tariff number	94056120
Country of origin	DEUTSCHLAND
EAN	4260659561253



TECHNICAL DRAWING

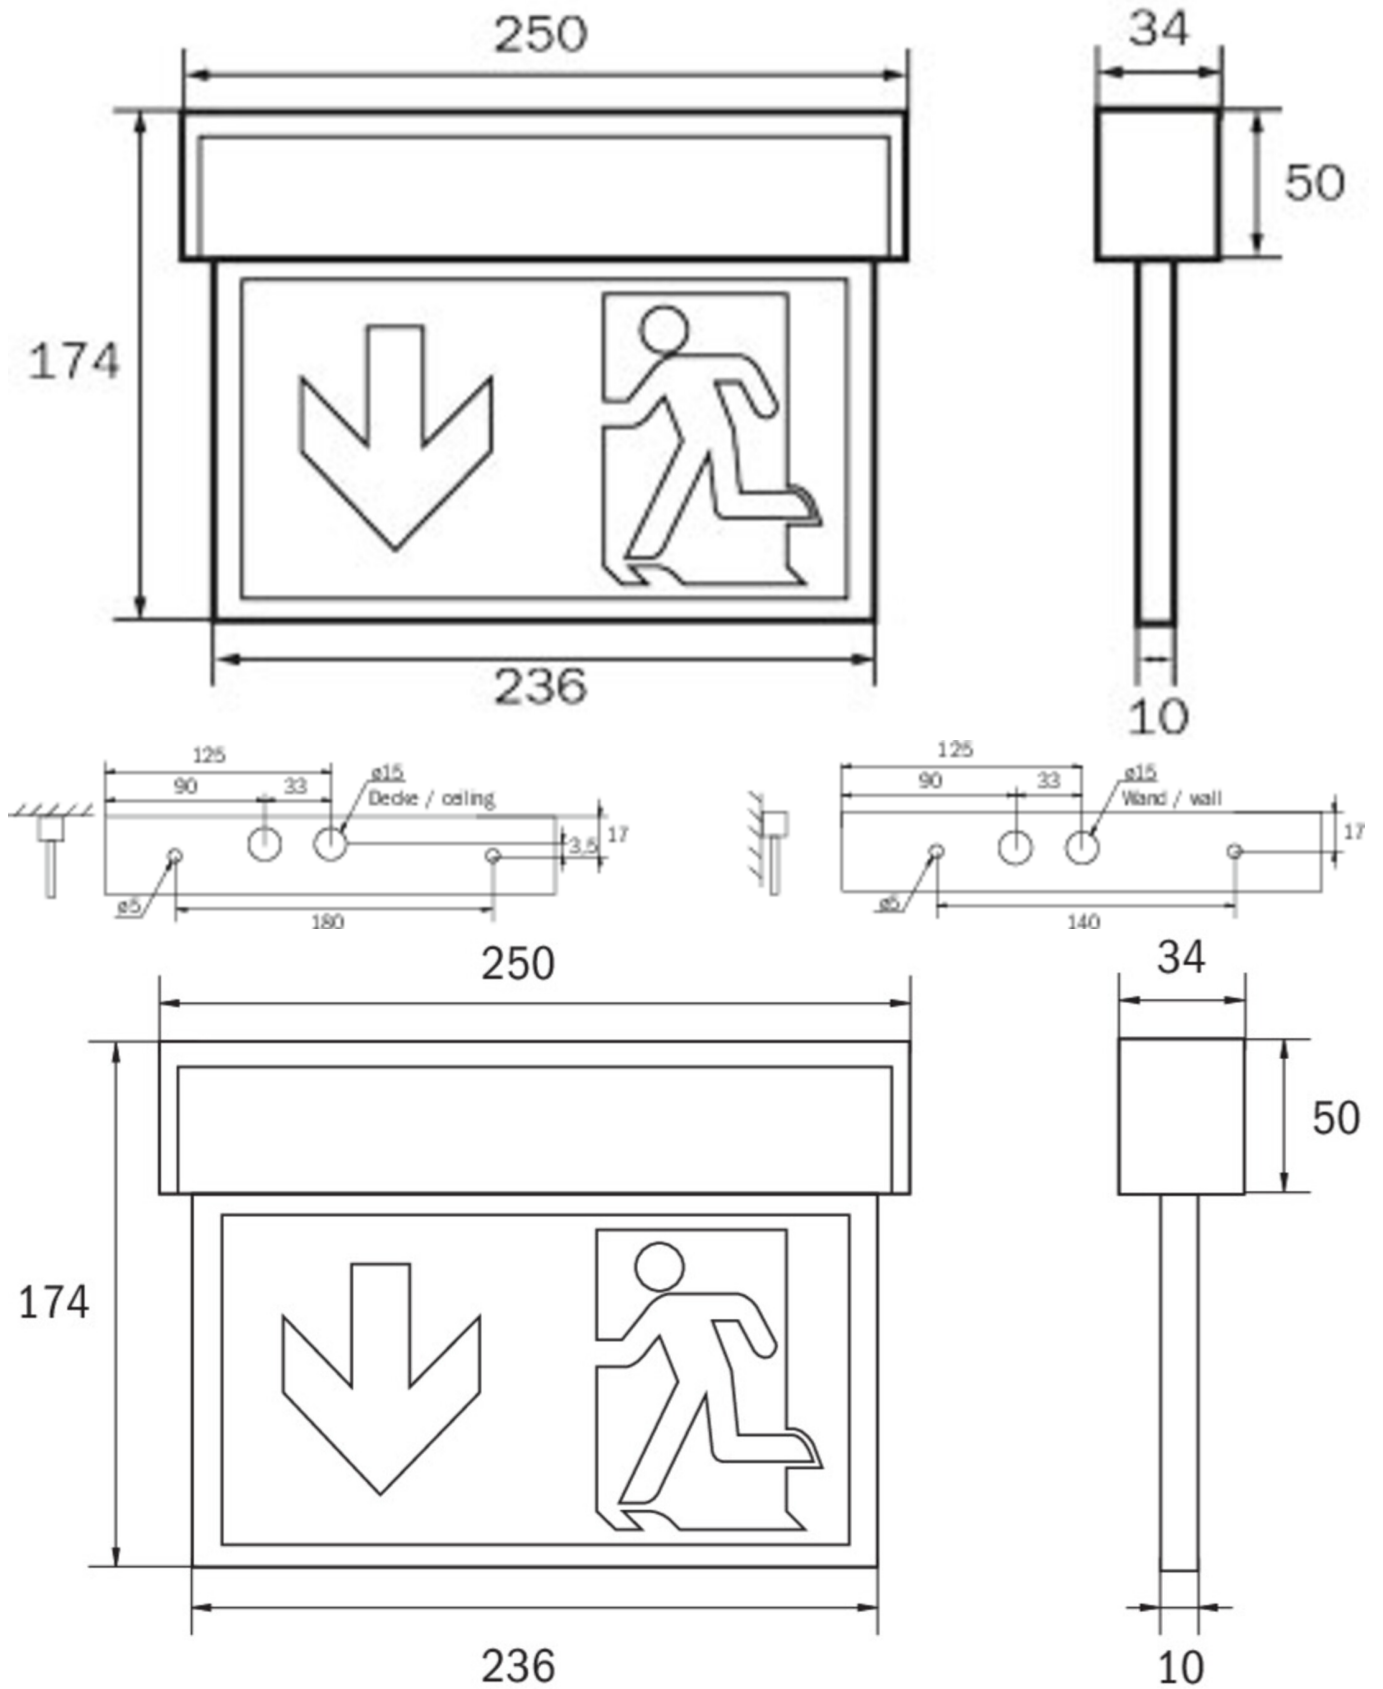



ACCESSORY LIST

KME-EB -
AWKSU -
2PW-EB -
KMBE -
BALLPLX-KMU -
DSA -
KSE-MB-WS -
KSE-MB-SI -



RELATED PRODUCTS

Art.-No.	Image	Monitoring	Supply	Color	Investment	Automatic log	Maintenance level	Remote maintenance	max. luminaires	Single luminaire monitoring
KSU018SC		SelfControl	Single battery		€	no	high	no	unlimited	itself
KSU018SC-G10		SelfControl	Single battery		€	no	high	no	unlimited	itself
KSU018WL		Wireless Professional	Single battery		€€	yes	low	yes	1,000 per system	central
KSU018WL-G10		Wireless Professional	Single battery		€€	yes	low	yes	1,000 per system	central

As of: 02.07.2024 - Subject to technical changes and errors.